


HE-RTU

HIGH-EFFICIENCY ROOF TOP UNITS



- Air-to-Air type heat pump
- Air flows from 18.000 to 60.000 m³/h
- Cooling capacities from 115 to 306 kW
- Heating capacities from 121 to 327 kW

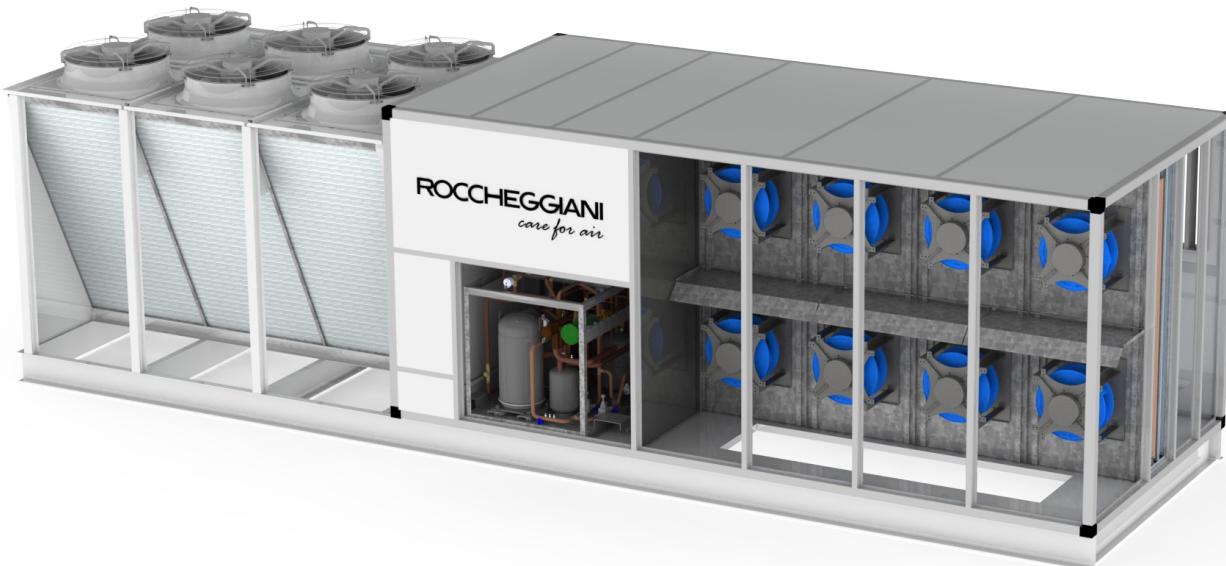

The High-Efficiency Roof Top Units from the Roccheggiani HE-RTU range are units designed to guarantee (based on the chosen configuration and accessories) air handling, renewal and purification inside buildings and are particularly beneficial in large production, storage and distribution areas within Industry and the Tertiary sector.

The units in the HE-RTU range are packaged units, designed to be installed outdoors (typically on the roof) and use heat pump technology enabling the units to be extremely compact and efficient.

The units in the HE-RTU range ensure high seasonal energy efficiency also at partial loads, with performances that contribute towards achieving the best energy classification levels in the building where they are installed. Upon request the units can be supplied together with a "Product Compliance Report", to assist the heating engineer, architectural designer or facility manager, in understanding the contribution provided by the HE-RTU units in terms of certification points for the major world protocols in the field of Green Buildings, such as LEED®, BREEAM®, Home Quality Mark®, Estidama® and HK Beam Plus®.

From a technical point of view, compared to traditional hydronic solutions consisting typically of plants with UTA, chillers and heat generators (which normally use fossil fuels), the use of high-efficiency Roof Top units from the HE-RTU range can provide better system efficiencies, reduced energy for pumping the various media fluids and lower primary energy consumption, thus facilitating better energy assessments for the plant-building system, based on the various relevant standards.

The Roccheggiani high-efficiency Roof Top units are manufactured in compliance with the UNI EN 12100 standard and the CE marking directives, following an ISO 9001/2000-certified quality assurance system and use R410A Gas as the refrigerant, in line with the applicable legislation.

Publication: Sales technical information sheet for high-efficiency rooftop units (HE-RTU)

Copyright © 2020: all rights reserved in all countries - Roccheggiani Spa

Technical data and information expressed in this preliminary publication are the property of Roccheggiani Spa and for general information purposes. With a view to making ongoing improvements, Roccheggiani Spa has the right to introduce at any time, without any obligation or commitment, whatever modifications it deems appropriate in order to improve the product. The pictures showing examples of components inside the units are for illustration purposes and therefore the brands of the components used to build the units, may differ from those brands shown in this document. This document was prepared with the utmost care and attention as regards the contents shown; nevertheless, Roccheggiani Spa cannot accept any liability arising from the direct or indirect use of the information contained in it.

Regulatory Compliance

All the High-Efficiency Roof Top Units in the HE-RTU range are assembled, tested under pressure, dehydrated, loaded and tested at a running test standard level before shipment. The Company's Quality System has been certified UNI EN ISO 9001 since 1996. In 2014 the Company was awarded UNI EN ISO 14001 Environmental Management certification. Over the years numerous certifications have been obtained for the various Roccheggiani product ranges from the most important European bodies (TÜV, EUROVENT, Istituto Giordano, VKF-AEAI, GOST, Achilles JQS, etc.). Specifically, the High-Efficiency Roof Top Units in the HE-RTU range are designed and manufactured in accordance with the following regulations:

- Directive 2006/42/EU - Machinery
- Directive 2014/30/EU - Electromagnetic Compatibility (EMC);
- Directive 2014/35/EU Low Voltage Directive (LVD)
- Directive 2014/68/EU - PED
- Directive 2009/125/EU - EcoDesign
- Regulation (EU) No. 2016/2281 (ErP)

Presentation of the scope of Application

The units have been designed to respond in a specialised manner to a wide spectrum of applications:



Industrial



Tertiary



Restaurants



Sports facilities



Cinemas/Theatres



Supermarkets



Medium-to-large sized shopping centres



Airports/Railway stations



Logistics


Composition of the units: housing and frame

The High-Efficiency Roof Top Units in the HE-RTU range are made in 3 main sections:

- air handling section;
- condensing/evaporating section;
- cooling section/electric power and control section.

All sections are firmly secured to a suitably reinforced perimeter base with a standard height of 190 mm, made in thick press-formed galvanised sheet steel, which provides adequate rigidity to the unit. The base is provided with holes to allow the unit to be lifted and also positioned wherever it is to be installed, normally on the roof of the building.

The housing is produced in such a way as to allow the units to be housed outside. If needed, for the Air Handling Section and the Cooling and Electric power and control Section, it is possible to fit units with an additional, separate, protective roof in order to improve the unit's isolation from direct sunlight, in summer, and reduce the response times during start-up after a stationary period.

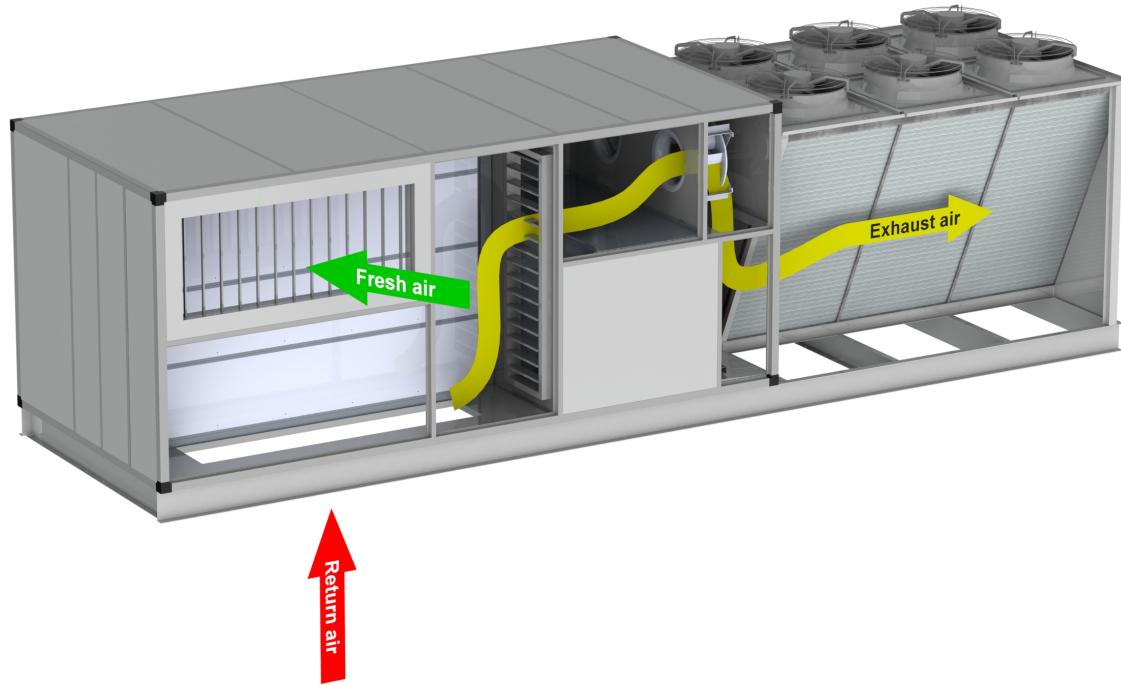


Casing

The housing in the air handling section of the High-Efficiency Roof Top Units in the HE-RTU range, is characterised by a load-bearing structure made from Anticorodal UNI 9006/1 T5 aluminium extruded profiles which are specially shaped to improve safety.

The profiles are joined together by three-way corner couplings made of fibreglass-reinforced nylon. The profile has a particular shape with the panel securing screws positioned in such a way that the interior parts of the units are completely flush and smooth. The profiles are 70 mm thick for 54 mm thick panels. The sandwich-type panels have a minimum thickness of 54 mm and are insulated with polyurethane foam (density approx. 45 kg/m³). The inside of the panel is in galvanised sheet metal and the outside is in pre-coated galvanised sheet metal.

Panels can be easily removed ensuring efficient access to the internal components for routine and major maintenance.

The sandwich type panels (sheet metal/polyurethane/sheet metal) were tested by the Istituto Giordano SpA according to the UNI 9177:1987 standard with the following results: - category 1 with the test method according to the UNI 8457 and UNI 8457/A1 standards - category 1 with the test method according to the UNI 9174 and UNI 9174/A1 standards.

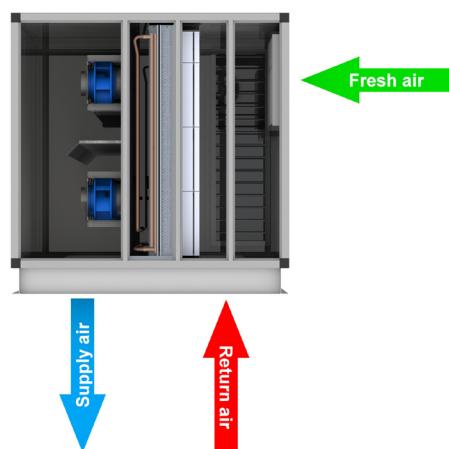

Air handling Section Components

Mixing box

The air handling section includes a mixing box with the fresh air intake and return air from the air-conditioned rooms, complete with a damper for regulating the fresh air flow and an overpressure damper for discharging waste air, both made of aluminium and fitted with seals that ensure optimum airtightness when the damper is closed.

The fresh air intake damper is equipped with a servo-motor to control the air flow and, in combination with the fan control, can provide freecooling of up to 50% of the total supply air flow.

Filters

In standard configurations, units use undulated synthetic-fibre filters with regenerative cells, 48 mm thick with self-extinguishing fibre filter section jointed with chlorine-vinyl resin, complete with galvanised steel frame with U-profile th.8/10, with double welded galvanised steel mesh. Filtering class: G4 according to standard EN 779.

In addition to the G4 filter supplied as standard, the units can be equipped with compact F9 efficiency filters, the seal between the filters and frame is guaranteed by a polyurethane sealant. Filtering class: F7 according to standard EN 779.

Handling section (Heating/Cooling)

Downstream of the filtering section there is one refrigerant/air heat exchanger dedicated to handling the supply air for the rooms to be air-conditioned, with copper pipes and aluminium fins.

The excellent heat exchange capacity is guaranteed by the mechanical expansion of the copper pipes inside the aluminium fin pack so as to ensure adequate heat transfer between the primary and secondary exchange surfaces. The heat exchanger is equipped with a condensation collection tray made of AISI 304 stainless steel, with condensation-proof insulation and is fitted with a drain hose.

The unit is complete with a hot-gas reheating heat exchange section, made with the same materials as the refrigerant/air heat exchanger dedicated to the handling of the supply air.

Utility Fan Section

In order for the supply of handled air towards the air-conditioned spaces, there are EC plug fans that have electronic rotation speed control, allow substantial energy savings compared to conventional double-suction ventilation systems and do not involve belt and pulley transmission, improving both reliability and durability.

Exhaust Air Fan Section

In order for the extraction of air from the air-conditioned spaces, there are EC plug fans that have electronic rotation speed control, allow substantial energy savings compared to conventional double-suction ventilation systems and do not involve belt and pulley transmission, improving both reliability and durability.

External Condenser/Evaporator fan Section

The High-Efficiency Roof Top Units in the HE-RTU range are equipped with an evaporator/condenser section with double circuit fitted with heat exchanger coils with copper tubes and aluminium fins and high efficiency axial fans with profiled blades in high-strength polymer, with IP54 internal overheating protection. The fans are equipped with Hyblade blades allowing greater air flow capacity with a reduction in the level of noise emitted.

Active thermodynamic heat recovery section

The High-Efficiency Roof Top Units in the HE-RTU range are equipped with an integrated recovery system of the active thermodynamic type. The exhaust air, extracted from the internal space, which usually has advantageous thermohygrometric conditions in terms of energy efficiency compared to the fresh air, before being expelled into the atmosphere, is mixed with the fresh air used for condensation or evaporation (depending on the summer-winter operating regime), thereby improving the cooling (summer) or heating (winter) performance.

During the winter, the active thermodynamic heat recovery unit enables the reduction of the number of defrosts due to the higher air temperature on the evaporator coil. The end result is a two-fold improvement of the COP, thanks to a significant increase in the evaporation temperature and a reduction in the number of defrosts that may be required.

Cooling and Electric power and control section components

Cooling Section

Except for the 100 size version that is a mono circuit (with 2 compressors and 3 capacity steps), all the other sizes in the HE-RTU range provide a dual circuit cooling section with 2 compressors for each circuit. This means there are 6 capacity steps and the following major components.

- Hermetic scroll compressors with orbiting spiral complete with motor protection against overheating, power surges and excessive temperatures in the supply gas. The compressors are mounted on rubber anti-vibration grommets and come complete with oil charge. The automatic oil heater prevents oil being diluted by the coolant when the compressor is shut down. The compressors are connected in TANDEM on a single cooling circuit and have bi-phasic oil equalisation.
- 4-way cycle reversing valve, electronic expansion valve, check valve, high pressure safety valve, liquid indicator, filter drier, liquid receiver, liquid separator, high pressure safety pressure switch, low pressure safety pressure switch and coolant charge.

Electric power and control section

The Electric power and control section varies according to the chosen configuration of the unit and is generally characterised by the following elements.

The power section includes:

- door-locking main isolation switch;
- compressor protection circuit breaker;
- compressor remote control switch;
- fan motor thermal protection on the internal section and external section;
- circuit breaker on auxiliary circuit.

The microprocessor control section includes:

- compressor protection and timing;
- compressor protection and timing; - clean contacts for remote ON-OFF, cumulative alarm, fire alarm input, fan status, compressor status, cooling/heating mode change;
- phase monitor;
- RJ45 connector placed on the external surface of the unit for inspection and maintenance operations.

Remote control with user interface:

- switching the unit ON and OFF;
- daily/weekly programming for switching the unit, or just the fan, ON or OFF;
- manual change of operating mode (hot or cold) and/or of the temperature set-point;
- display of alarms and machine status;
- management of the main operating parameters (password protected);
- selective key locking with password-protected release;
- power section with dedicated electric panel;
- control and user interface.

The integrated automatic control of the unit controls and monitors operations and set-points. The control system is based on a programmable microprocessor control for HVAC/R systems.

General technical data

Model HE-RTU		100	150	200	250	300	
Performance							
Total Cooling Capacity	(1)(2)	kW	114.8	163.9	229.6	264	306.2
Sensible Cooling Capacity	(1)(2)	kW	83.8	119.7	167.6	192.7	223.5
Absorbed power	(1)(2)	kW	27.8	40.2	55.6	63.6	74.8
EER Compressors only	(1)(2)(3)		4.13	4.08	4.13	4.15	4.09
Total Heating Capacity	(4)(5)	kW	120.7	176.1	242.3	280.9	326.9
Absorbed power	(4)(5)	kW	24.2	35.1	48.3	55.6	65.1
COP Compressor only	(4)(5)(6)		5	5.02	5.02	5.05	5.02
Reheating							
Total Cooling Capacity	(7)	kW	44.6	63.7	88.9	98.5	119.6
Utility fan section							
Fan Type			Radial EC				
Fan Quantity		no.	4	4	6	6	8
Impeller Diameter		mm	450	450	450	450	450
Airflow		m³/h	20000	26000	37000	46000	56000
Single fan motor rating		m³/h	5.2	5.2	5.2	5.2	5.2
External Static Pressure	(8)	Pa	1200	1100	1100	1000	1000
Waste air fan section							
Fan Type			Radial EC				
Fan Quantity		no.	2	2	2	2	2
Impeller Diameter		mm	500	500	560	560	560
Airflow		m³/h	10000	13000	18500	23000	28000
Single fan motor rating		kW	3.5	3.5	5.0	5.0	5.0
Fresh air intake							
Airflow		m³/h	10000	13000	18500	23000	28000
External Fan Section (Condensing-Evaporating)							
Fan Type			Axial EC				
Fan Quantity		no.	4	4	4	4	6
Impeller Diameter		mm	710	710	800	800	800
Airflow		m³/h	64000	64000	88000	88000	132000
Supply Fan Motor Rating		kW	1.95	1.95	3.1	3.1	3.1
Compressors							
Compressor			Scroll	Scroll	Scroll	Scroll	Scroll
Total Compressor Number		no.	2	4	4	4	4
Tandem			uneven	uneven	uneven	uneven	uneven
Number of Refrigeration Circuit		no.	1	2	2	2	2
Capacity step		no.	3	6	6	6	6
Refrigerant			R410A	R410A	R410A	R410A	R410A

Notes:

- Internal Air Temperature 27°C B.S./19°C B.U. Fresh Air Temperature 35°C B.S./24°C B.U. (According to EN14511 - Table 4 - Cooling Mode);
- Performance with 30% fresh air and recovery activation with waste air;
- EER refers only to cooling compressors;
- Internal Air Temperature 20°C B.S./12°C B.U. Fresh Air Temperature 7°C B.S./6°C B.U. (According to EN14511 - Table 3 - Heating Mode);
- Performance with 30% fresh air and recovery activation with waste air;
- COP refers only to cooling compressors;
- Heating power in hot gas reheating operation in summer conditions, referred to inlet air temperature at the reheating coil of 14°C and fresh air temperature of 35°C;
- External static pressure (maximum available) overall for the return air intake from the rooms and for supply, with clean standard G4 filter;

Electrical Data

Model HE-RTU	100	150	200	250	300
FLA Maximum current allowable					
Compressor 1	A	34.0	22.0	34.0	34.0
Compressor 2	A	40.0	34.0	40.0	48.50
Compressor 3	A	-	22.0	34.0	34.0
Compressor 4	A	-	34.0	40.0	48.50
User single fan	A	8.40	8.40	8.40	8.40
External single fan	A	3.20	3.20	4.80	4.80
Total FLA	A	131.60	169.60	233.60	250.60
LRA Inrush current					
Compressor 1	A	174.0	118.0	174.0	174.0
Compressor 2	A	225.0	174.0	225.0	272.0
Compressor 3	A	-	118.0	174.0	174.0
Compressor 4	A	-	174.0	225.0	272.0
FLI maximum power absorption					
Compressor 1	kW	17.0	11.90	17.0	17.0
Compressor 2	kW	22.60	17.0	22.60	27.60
User single fan	kW	5.20	5.20	5.20	5.20
External single fan	kW	3.20	3.20	4.80	4.80
Total FLI	kW	80.20	98.20	139.50	149.50
MIC Maximum inrush current					
Value	A	316.60	309.60	418.60	474.10
Power Supply					
Power supply				400V / 3 Phases / 50 Hz	

Noise levels

Sound powers

HE RTU 100	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB (A)
Supply	76.0	82.0	84.0	82.0	83.0	80.0	76.0	71.0	87.10
Return	75.0	79.0	82.0	79.0	73.0	70.0	66.0	63.0	80.0
Axial (total)	81.0	84.0	84.0	83.0	85.0	81.0	77.0	72.0	88.40
Unit external radiation	82.0	85.0	85.0	84.0	86.0	82.0	78.0	73.0	89.40
Optional									
Supply with structural silencer	74.10	76.20	73.70	68.50	69.50	67.60	62.80	65.60	74.50
Axial (AxiBlade)	72.0	76.0	79.0	82.0	85.0	82.0	75.0	69.0	87.70
HE RTU 150	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB (A)
Supply	76.0	82.0	84.0	82.0	83.0	80.0	76.0	71.0	87.10
Return	75.0	79.0	82.0	79.0	73.0	70.0	66.0	63.0	80.0
Axial (total)	81.0	84.0	84.0	83.0	85.0	81.0	77.0	72.0	88.40
Unit external radiation	82.0	85.0	85.0	84.0	86.0	82.0	78.0	73.0	89.40
Optional									
Supply with structural silencer	74.10	76.20	73.70	68.50	69.50	67.60	62.80	65.60	74.50
Axial (AxiBlade)	72.0	76.0	79.0	82.0	85.0	82.0	75.0	69.0	87.70
HE RTU 200	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB (A)
Supply	76.0	82.0	84.0	82.0	83.0	80.0	76.0	71.0	87.10
Return	75.0	79.0	82.0	79.0	73.0	70.0	66.0	63.0	80.0
Axial (total)	81.0	84.0	84.0	83.0	85.0	81.0	77.0	72.0	88.40
Unit external radiation	82.0	85.0	85.0	84.0	86.0	82.0	78.0	73.0	89.40
Optional									
Supply with structural silencer	74.10	76.20	73.70	68.50	69.50	67.60	62.80	65.60	74.50
Axial (AxiBlade)	72.0	76.0	79.0	82.0	85.0	82.0	75.0	69.0	87.70
HE RTU 250	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB (A)
Supply	76.0	82.0	84.0	82.0	83.0	80.0	76.0	71.0	87.10
Return	75.0	79.0	82.0	79.0	73.0	70.0	66.0	63.0	80.0
Axial (total)	81.0	84.0	84.0	83.0	85.0	81.0	77.0	72.0	88.40
Unit external radiation	82.0	85.0	85.0	84.0	86.0	82.0	78.0	73.0	89.40
Optional									
Supply with structural silencer	74.10	76.20	73.70	68.50	69.50	67.60	62.80	65.60	74.50
Axial (AxiBlade)	72.0	76.0	79.0	82.0	85.0	82.0	75.0	69.0	87.70
HE RTU 300	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB (A)
Supply	76.0	82.0	84.0	82.0	83.0	80.0	76.0	71.0	87.10
Return	75.0	79.0	82.0	79.0	73.0	70.0	66.0	63.0	80.0
Axial (total)	81.0	84.0	84.0	83.0	85.0	81.0	77.0	72.0	88.40
Unit external radiation	82.0	85.0	85.0	84.0	86.0	82.0	78.0	73.0	89.40
Optional									
Supply with structural silencer	74.10	76.20	73.70	68.50	69.50	67.60	62.80	65.60	74.50
Axial (AxiBlade)	72.0	76.0	79.0	82.0	85.0	82.0	75.0	69.0	87.70

Notes:

The sound levels refer to the individual fan sections for the unit under full load in nominal test conditions with useful static pressure of 50 Pa. The total of the units includes some corrective factors resulting from some typical application solutions. If the unit is installed under conditions other than nominal test conditions, the sound levels may be subject to change, including substantial changes. Tolerance +/-4dB

Operating Limits

Model HE-RTU			100	150	200	250	300
Summer							
Minimum fresh air temperature	(11) (12)	°C	15.0	15.0	15.0	15.0	15.0
Maximum fresh air temperature	(11) (12)	°C	44.0	44.0	44.0	44.0	44.0
Min. temperature of air entering handling coil	(11) (12)	°C	13.0	13.0	13.0	13.0	13.0
Max. temperature of air entering handling coil	(11) (12)	°C	26.0	26.0	26.0	26.0	26.0
Winter							
Minimum fresh air temperature	(11) (12)	°C	-10.0	-10.0	-10.0	-10.0	-10.0
Maximum fresh air temperature	(11) (12)	°C	18.0	18.0	18.0	18.0	18.0
Min. temperature of air entering handling coil	(11) (12)	°C	10.0	10.0	10.0	10.0	10.0
Max. temperature of air entering handling coil	(11) (12)	°C	24.0	24.0	24.0	24.0	24.0

Notes:

11. Valid limits for nominal air flow, correct use and installation of the unit and full load operation.
12. Values expressed taking account of renewal through fresh air and activation of recovery.

Operating range

Campo di lavoro alle diverse portate d'aria di mandata e relativi valori di potenza frigorifera



Performance under diverse conditions, indoors and outdoors

HE-RTU 100

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	20/12			25/18			30/22			35/24			40/25			45/26								
		D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
20.000 m³/h	22/16	101,9	77,8	19,6	5,2	112,2	80,0	22,0	5,1	112,3	77,7	24,5	4,6	108,8	78,1	27,3	3,9	103,9	79,5	30,3	3,4	102,4	84,0	34,1	3,0
	24/17	104,7	80,0	19,7	5,3	114,1	82,3	22,2	5,2	114,4	80,6	24,7	4,6	111,1	80,8	27,5	4,5	105,7	82,1	30,5	3,5	102,8	87,6	34,3	2,9
	26/18	107,4	82,2	19,9	5,4	112,6	82,3	22,4	5,03	116,3	83,3	24,8	4,7	112,9	83,8	27,6	4,1	107,4	84,8	30,6	3,5	105,6	89,3	34,9	3,03
	27/19	109,5	82,2	20	5,5	113,0	80,7	22,6	5,01	116,4	82,1	25	4,7	114,8	83,8	27,8	4,1	109,3	84,8	30,8	3,5	108,2	88,9	35,3	3,06
	28/20	111,7	82,2	20,1	5,5	113,4	79,1	22,7	4,9	116,6	80,9	25,1	4,6	116,7	83,7	28	4,2	111,2	84,9	31	3,6	110,8	88,6	35,7	3,1
	30/22	116,1	81,9	20,4	5,7	118,0	78,2	23,1	5,1	117,1	78,1	25,4	4,6	120,7	83,3	28,4	4,2	115,2	84,9	31,4	3,6	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																				
Airflow	Ta (°C)	-7/-8			-5/-6			0/-1			2/1			7/6			12/11			
		D.B.	kWt	kWe	COP	kWt	kWe	COP												
20.000 m³/h	10	87,5	15,8	5,5	91,9	16,5	5,6	103,3	18,2	5,6	107,7	18,9	5,7	118,9	20,7	5,7	130,5	22,9	5,7	
	15	87,8	17,2	5,1	92,0	17,9	5,1	104,8	19,6	5,3	109,8	20,4	5,4	120,5	22,5	5,4	131,8	24,8	5,3	
	18	87,8	18,0	4,8	92,2	18,7	4,9	104,8	20,6	5,1	109,7	21,4	5,1	121,1	23,6	5,1	131,9	25,7	5,1	
	20	88,2	18,7	4,7	92,6	19,3	4,8	104,8	21,2	4,9	109,6	22,1	4,9	120,7	24,2	5	131,5	26,2	5,03	
	22	88,6	19,2	4,6	92,9	19,9	4,7	104,8	21,9	4,8	109,3	22,7	4,8	119,9	24,6	4,9	131,1	26,6	4,9	
	25	89,1	20,1	4,4	93,4	20,8	4,5	104,6	22,8	4,6	108,8	23,5	4,6	118,5	25,2	4,7	130,3	27,5	4,7	

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	20/12			25/18			30/22			35/24			40/25			45/26								
		D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
20.000 m³/h	22/16	100,4	76,9	20,1	5,0	110,5	79,1	22,6	4,9	110,7	76,9	25,1	4,4	107,2	77,2	27,9	3,8	102,4	78,6	31,0	3,3	100,9	83,0	35,0	2,9
	24/17	103,2	79,1	20,2	5,1	112,4	81,4	22,7	4,9	112,7	79,7	25,3	4,5	109,5	79,9	28,2	3,9	104,2	81,1	31,2	3,3	101,3	86,6	35,2	2,9
	26/18	105,8	81,2	20,4	5,2	111,0	81,4	22,9	4,8	114,6	82,4	25,5	4,5	111,3	82,9	28,3	3,9	105,8	83,8	31,4	3,4	104,1	88,3	35,7	2,9
	27/19	107,9	81,3	20,5	5,3	111,4	79,8	23,1	4,8	114,7	81,2	25,6	4,5	113,1	82,9	28,5	3,9	107,7	83,9	31,6	3,4	106,6	87,9	36,2	2,9
	28/20	110,0	81,2	20,7	5,3	111,7	78,2	23,3	4,8	114,9	79,9	25,8	4,5	115,0	82,8	28,7	4,0	109,6	83,9	31,8	3,4	109,2	87,6	36,6	3,0
	30/22	114,4	81,0	20,9	5,5	116,3	77,3	23,6	4,9	115,3	77,2	26,1	4,4	118,9	82,3	29,1	4,1	113,5	83,9	32,2	3,5	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																				
Airflow	Ta (°C)	-7/-8			-5/-6			0/-1			2/1			7/6			12/11			
		D.B.	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP
20.000 m³/h	10	83,4	15,6	5,3	87,6	16,2	5,4	98,4	17,9	5,5	102,6	18,6	5,5	113,3	20,4	5,5	124,3	22,5	5,5	
	15	83,7	17,0	4,9	87,6	17,6	5,0	99,9	19,3	5,9	104,6	20,1	5,2	114,8	22,1	5,2	125,6	24,4	5,1	
	18	83,7	17,7	4,7	87,8	18,4	4,8	99,9	20,2	4,9	104,5	21,1	4,9	115,4	23,2	4,9	125,7	25,3	4,9	
	20	84,0	18,4	4,6	88,2	19,0	4,6	99,9	20,9	4,8	104,4	21,7	4,8	115,0	23,8	4,8	125,3	25,7	4,9	
	22	84,4	18,9	4,5	88,5	19,6	4,5	99,8	21,5	4,6	104,2	22,3	4,7	114,2	24,2	4,7	124,9	26,1	4,8	
	25	84,9	19,8	4,3	89,0	20,4	4,3	99,7	22,4	4,4	103,6	23,1	4,5	112,9	24,8	4,5	124,2	27,0	4,6	

Notes:

kWf = Cooling capacity in kW

kWe = Electrical power absorbed by the compressors in kW

kWs = Sensitive cooling capacity in kW

kWt = Heating capacity provided (kW)

EER referred only to compressors

COP referred only to compressors

Ta = Room air temperature D.B./W.B.

D.B. = Dry bulb

W.B. = Wet bulb

The cooling and heating performances do not take account of the heat dissipated by the motors and fans.

HE-RTU 150

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.			20/12				25/18				30/22				35/24				40/25				45/26			
Airflow	Ta (°C)	D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER
26.000 m³/h	22/16	145,6	111,1	28,3	5,1	160,2	114,2	31,9	5,03	160,4	111,0	35,5	4,5	155,4	111,6	39,4	3,9	148,3	113,6	43,8	3,4	146,2	119,9	49,4	2,9	
	24/17	149,5	114,2	28,6	5,2	162,9	117,5	32,0	5,1	163,3	115,1	35,7	4,6	158,7	115,4	39,7	4,0	151,0	117,2	44,0	3,4	146,8	125,1	49,6	2,9	
	26/18	153,4	117,3	28,7	5,3	160,8	117,5	32,3	4,9	166,1	119,0	35,9	4,6	161,3	119,7	39,9	4,04	153,3	121,1	44,3	3,5	150,8	127,5	50,4	3,0	
	27/19	156,4	117,4	28,9	5,4	161,4	115,2	32,6	4,9	166,3	117,3	36,1	4,6	163,9	119,7	40,2	4,1	156,0	121,1	44,6	3,5	154,5	127,0	51,1	3,03	
	28/20	159,5	117,3	29,1	5,8	161,9	112,9	32,9	4,9	166,5	115,5	36,4	4,6	166,7	119,5	40,5	4,1	158,8	121,2	44,8	3,5	158,3	126,5	51,7	3,06	
	30/22	165,9	116,9	29,5	5,6	168,5	111,7	33,4	5,05	167,2	111,5	36,8	4,5	172,3	118,9	41,0	4,2	164,5	121,2	45,5	3,6	-	-	-	-	

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.			-7/-8				-5/-6				0/-1				2/1				7/6				12/11			
Airflow	Ta (°C)	D.B.	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP
26.000 m³/h	10	127,7	23,0	5,5	134,1	23,9	5,6	150,6	26,5	5,7	157,0	27,5	5,7	173,4	30,1	5,8	190,3	33,3	5,7	192,3	36,1	5,3	192,4	37,4	5,1	
	15	128,0	25,0	5,1	134,1	25,9	5,9	152,9	28,4	5,4	160,1	29,6	5,4	175,7	32,6	5,4	192,3	36,1	5,3	191,8	38,0	5,05	191,1	38,6	4,9	
	18	128,1	26,2	4,9	134,4	27,2	4,9	152,9	29,8	5,1	160,0	31,1	5,1	176,7	34,3	5,1	192,4	37,4	5,1	191,8	38,0	5,05	191,1	38,6	4,9	
	20	128,6	27,1	4,7	135,0	28,0	4,8	152,9	30,8	5,0	159,8	32,1	5,0	176,1	35,1	5,02	191,8	38,0	5,05	191,1	38,6	4,9	190,1	39,9	4,8	
	22	129,2	27,9	4,6	135,5	28,9	4,7	152,8	31,8	4,8	159,5	32,9	4,8	174,8	35,7	4,9	191,1	38,6	4,9	190,1	39,9	4,8	190,1	39,9	4,8	
	25	130,0	29,2	4,4	136,2	30,2	4,5	152,5	33,0	4,6	158,6	34,1	4,7	172,8	36,6	4,7	190,1	39,9	4,8	190,1	39,9	4,8	190,1	39,9	4,8	

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.			20/12				25/18				30/22				35/24				40/25				45/26			
Airflow	Ta (°C)	D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER
26.000 m³/h	22/16	143,4	109,9	29,1	4,9	157,8	112,9	32,7	4,8	158,1	109,8	36,3	4,3	153,1	110,3	40,4	3,8	146,2	112,3	44,9	3,7	144,1	118,6	50,6	2,8	
	24/17	147,3	112,9	29,3	5,03	160,5	116,2	32,8	4,9	160,9	113,8	36,6	4,4	156,3	114,1	40,7	3,8	148,8	115,9	45,1	3,3	144,6	123,7	50,9	2,8	
	26/18	151,1	116,0	29,4	5,1	158,5	116,2	33,2	4,8	163,7	117,6	36,8	4,4	158,9	118,4	40,9	3,9	151,1	119,7	45,4	3,3	148,6	126,0	51,7	2,9	
	27/19	154,1	116,0	29,6	5,2	159,0	113,9	33,4	4,7	163,8	115,9	37,0	4,4	161,5	118,3	41,2	3,9	153,7	119,8	45,7	3,7	152,2	125,6	52,3	2,9	
	28/20	157,2	116,0	29,9	5,7	159,6	111,7	33,7	4,7	164,0	114,2	37,3	4,4	164,2	118,2	41,5	4,0	165,5	119,8	46,0	3,4	155,9	125	53,0	2,9	
	30/22	163,4	115,6	30,2	5,4	166,1	110,4	34,2	4,8	164,7	110,3	37,7	4,4	169,8	117,5	42,1	4,0	162,1	119,8	46,6	3,5	-	-	-	-	

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.			-7/-8				-5/-6				0/-1				2/1				7/6				12/11			
Airflow	Ta (°C)	D.B.	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP
26.000 m³/h	10	121,6	22,6	5,4	127,8	23,5	5,4	143,5	26,0	5,5	149,6	27,0	5,5	165,2	29,6	5,6	181,3	32,7	5,5	183,2	35,5	5,7	183,3	36,7	5,0	
	15	122,0	24,6	5,0	127,8	25,5	5,01	145,7	28,0	5,2	152,6	29,1	5,2	167,4	32,1	5,2	183,3	36,7	5,0	183,3	36,7	5,0	182,7	37,4	4,9	
	18	122,1	25,8	4,7	128,1	26,7	4,8	145,7	29,4	5,0	152,4	30,6	5,0	168,3	33,7	5,0	183,3	36,7	5,0	182,1	38,0	4,8	181,1	39,2	4,6	
	20	122,6	26,7	4,6	128,6	27,5	4,8	145,7	30,3	4,8	152,3	31,6	4,8	167,8	34,5	4,9	182,7	37,4	4,9	181,1	39,2	4,6	181,1	39,2	4,6	
	22	123,1	27,5	4,5	129,1	28,4	4,5	145,6	31,2	4,7	152,0	32,4	4,7	166,6	35,1	4,7	182,1	38,0	4,8	181,1	39,2	4,6	181,1	39,2	4,6	
	25	123,9	28,7	4,3	129,8	29,7	4,4	145,3	32,5	4,5	151,1	33,5	4,5	164,7	36,0	4,6	181,1	39,2	4,6	181,1	39,2	4,6	181,1	39,2	4,6	

Notes:

KWf = Cooling capacity in kW

kWe = Electrical power absorbed by the compressors in kW

kWs = Sensitive cooling capacity in kW

kWt = Heating capacity provided (kW)

EER referred only to compressors

COP referred only to compressors

Ta = Room air temperature D.B./W.B.

D.B. = Dry bulb

W.B. = Wet bulb

The cooling and heating performances do not take account of the heat dissipated by the motors and fans.

HE-RTU 200

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	20/12			25/18			30/22			35/24			40/25			45/26								
		D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
37.000 m³/h	22/16	203,9	155,6	39,2	5,2	224,3	159,9	44,1	5,1	224,7	155,5	49,0	4,6	217,6	156,2	54,5	4,0	207,8	159,0	60,6	3,4	204,8	167,9	68,3	3,0
	24/17	209,4	159,9	39,5	5,3	228,2	164,6	44,3	5,1	228,7	161,2	49,3	4,6	222,2	161,6	54,9	4,04	211,5	164,1	60,9	3,5	205,6	175,2	68,6	3,0
	26/18	214,8	164,3	39,7	5,4	225,2	164,6	44,7	5,0	232,7	166,6	49,7	4,7	225,8	167,7	55,2	4,1	214,7	169,6	61,2	3,5	211,3	178,5	69,7	3,03
	27/19	219,1	164,4	40,0	5,9	226,0	161,4	45,1	5,0	232,9	164,2	50,0	4,7	229,6	167,6	55,6	4,1	218,5	169,6	61,6	3,5	216,4	177,9	70,6	3,1
	28/20	223,4	164,3	40,3	5,5	226,8	158,2	45,5	5,0	233,2	161,7	50,3	4,6	233,4	167,4	56,0	4,8	222,4	169,7	62,0	3,6	221,7	177,1	71,5	3,1
	30/22	232,3	163,8	40,8	5,7	236,0	156,5	46,1	5,1	234,1	156,2	50,9	4,6	241,3	166,5	56,8	4,2	230,4	169,7	62,9	3,7	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																							
Airflow	Ta (°C)	-7/-8			-5/-6			0/-1			2/1			7/6			12/11						
		D.B.	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP												
37.000 m³/h	10	175,7	31,7	5,5	184,5	32,9	5,6	207,3	36,5	5,7	216,1	37,9	5,7	238,7	41,5	5,7	261,9	45,8	5,7				
	15	176,2	34,5	5,1	184,6	35,7	5,2	210,5	39,2	5,4	220,4	40,8	5,4	241,8	45,0	5,4	264,6	49,7	5,3				
	18	176,3	36,1	4,9	185,0	37,4	4,9	210,4	41,1	5,1	220,2	42,8	5,1	243,1	47,2	5,1	264,7	51,5	5,1				
	20	177,0	37,3	4,7	185,8	38,6	4,8	210,4	42,4	4,9	219,9	44,2	5,0	242,3	48,3	5,02	263,9	52,3	5,04				
	22	177,8	38,5	4,6	186,5	39,8	4,7	210,3	43,7	4,8	219,5	45,4	4,8	240,6	49,2	4,9	263,1	53,2	4,9				
	25	178,9	40,3	4,4	187,5	41,6	4,5	209,9	45,5	4,6	218,3	46,9	4,6	237,9	50,4	4,7	261,6	54,9	4,8				

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	20/12			25/18			30/22			35/24			40/25			45/26								
		D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
37.000 m³/h	22/16	200,9	153,9	40,2	5,0	221,0	158,1	45,2	4,9	221,4	153,7	50,3	4,4	214,4	154,5	55,9	3,8	204,7	157,3	62,1	3,3	201,8	166,0	70,0	2,9
	24/17	206,3	158,1	40,5	5,1	224,8	162,7	45,4	4,9	225,4	159,4	50,6	4,5	218,9	159,8	56,3	3,9	208,4	162,3	62,4	3,3	202,6	173,2	70,4	2,9
	26/18	211,7	162,5	40,7	5,2	221,9	162,7	45,9	4,8	229,3	164,8	50,9	4,5	222,5	165,8	56,6	3,9	211,6	167,7	62,7	3,4	208,2	176,5	71,5	2,9
	27/19	215,8	162,5	41,0	5,7	222,7	159,6	46,2	4,8	229,5	162,4	51,2	4,5	226,2	165,7	57	3,9	215,3	167,7	63,2	3,4	213,2	175,8	72,4	2,9
	28/20	220,1	162,5	41,3	5,3	223,5	156,4	46,6	4,8	229,7	159,9	51,5	4,5	230,0	165,5	57,4	4,0	219,1	167,8	63,6	3,4	218,4	175,1	73,3	3,0
	30/22	228,9	161,9	41,8	5,5	232,6	154,7	47,3	4,9	230,7	154,4	52,1	4,4	237,8	164,6	58,2	4,1	227,0	167,8	64,5	3,5	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																							
Airflow	Ta (°C)	-7/-8			-5/-6			0/-1			2/1			7/6			12/11						
		D.B.	kWt	kWe	COP	kWt	kWe	COP															
37.000 m³/h	10	167,4	31,2	5,4	175,8	32,4	5,4	197,5	35,9	5,5	205,9	37,2	5,5	227,4	40,8	5,6	249,5	45,1	5,5				
	15	167,9	33,9	4,9	175,9	35,1	5,0	200,5	38,5	5,2	210,0	40,1	5,2	230,4	44,2	5,2	252,1	48,9	5,7				
	18	168,0	35,5	4,7	176,3	36,8	4,8	200,5	40,4	4,9	209,8	42,1	5,0	231,7	46,4	5,0	252,3	50,6	5,0				
	20	168,7	36,7	4,6	177,0	37,9	4,7	200,5	41,7	4,8	209,6	43,5	4,8	230,9	47,5	4,8	251,5	51,5	4,9				
	22	169,5	37,9	4,5	177,7	39,1	4,5	200,4	43,0	4,7	209,1	44,6	4,7	229,2	48,3	4,7	250,6	52,3	4,8				
	25	170,5	39,6	4,3	178,6	40,9	4,4	200,0	44,8	4,5	208,0	46,1	4,5	226,6	49,6	4,6	249,2	54,0	4,6				

Notes:

kWf = Cooling capacity in kW

kWe = Electrical power absorbed by the compressors in kW

kWs = Sensitive cooling capacity in kW

kWt = Heating capacity provided (kW)

EER referred only to compressors

COP referred only to compressors

Ta = Room air temperature D.B./W.B.

D.B. = Dry bulb

W.B. = Wet bulb

The cooling and heating performances do not take account of the heat dissipated by the motors and fans.

HE-RTU 250

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	D.B./W.B.	20/12			25/18			30/22			35/24			40/25			45/26							
			kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
46.000 m³/h	22/16	234,4	178,9	44,8	5,2	257,9	183,9	50,4	5,1	258,3	178,8	56,1	4,6	250,2	179,6	62,3	4,0	238,8	182,8	69,3	3,4	235,5	193,1	78,1	3,0
	24/17	240,7	183,9	45,2	5,3	262,3	189,2	50,7	5,2	262,9	185,4	56,4	4,7	255,5	185,8	62,8	4,1	243,1	188,7	69,7	3,5	236,3	201,4	78,5	3,0
	26/18	246,9	188,9	45,4	5,4	258,9	189,2	51,2	5,1	267,5	191,6	56,8	4,7	259,6	192,7	63,2	4,1	246,9	194,9	70,0	3,5	242,9	205,2	79,8	3,0
	27/19	251,8	189,0	45,8	5,5	259,9	185,5	51,6	5,0	267,7	188,8	57,2	4,7	264	192,7	63,6	4,1	251,2	195,0	70,5	3,6	248,8	204,5	80,8	3,1
	28/20	256,8	188,9	46,1	5,6	260,7	181,8	52,0	5,0	268,0	185,9	57,5	4,7	268,4	192,4	64,0	4,2	255,7	195,1	70,9	3,6	254,8	203,6	81,8	3,1
	30/22	267,0	188,3	46,7	5,7	271,4	179,9	52,8	5,1	269,1	179,5	58,2	4,6	277,4	191,4	64,9	4,3	264,8	195,1	71,9	3,7	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																							
Airflow	Ta (°C)	D.B./W.B.	-7/-8			-5/-6			0/-1			2/1			7/6			12/11					
			kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP			
46.000 m³/h	10	175,7	31,7	5,5	184,5	32,9	5,6	207,3	36,5	5,7	216,1	37,9	5,7	238,7	41,5	5,7	261,9	45,8	5,7				
	15	176,2	34,5	5,1	184,6	35,7	5,2	210,5	39,2	5,4	220,4	40,8	5,4	241,8	45,0	5,4	264,6	49,7	5,3				
	18	176,3	36,1	4,9	185,0	37,4	4,9	210,4	41,1	5,1	220,2	42,8	5,1	243,1	47,2	5,1	264,7	51,5	5,1				
	20	177,0	37,3	4,7	185,8	38,6	4,8	210,4	42,4	5,0	219,9	44,2	5,0	242,3	48,3	5,0	263,9	52,3	5,0				
	22	177,8	38,5	4,6	186,5	39,8	4,7	210,3	43,7	4,8	219,5	45,4	4,8	240,6	49,2	4,9	263,1	53,2	4,9				
	25	178,9	40,3	4,4	187,5	41,6	4,5	209,9	45,5	4,6	218,3	46,9	4,6	237,9	50,4	4,7	261,6	54,9	4,8				

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	D.B./W.B.	20/12			25/18			30/22			35/24			40/25			45/26							
			kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
46.000 m³/h	22/16	230,9	176,9	46,0	5,0	254,1	181,8	51,7	4,9	254,5	176,7	57,5	4,4	246,5	177,6	63,9	3,9	235,3	180,8	71,0	3,3	232,0	190,9	80,1	2,9
	24/17	237,2	181,8	46,3	5,1	258,4	187,1	51,9	5,0	259,1	183,3	57,8	4,5	251,7	183,7	64,4	3,9	239,5	186,5	71,4	3,3	232,8	199,1	80,5	2,9
	26/18	243,3	186,8	46,6	5,2	255,1	187,1	52,5	4,9	263,6	189,4	58,3	4,5	255,8	190,6	64,8	3,9	243,2	192,7	71,8	3,4	239,3	202,9	81,8	2,9
	27/19	248,1	186,8	46,9	5,3	256,0	183,4	52,9	4,8	263,8	186,7	58,6	4,5	260,1	190,5	65,2	4,0	247,5	192,8	72,3	3,4	245,1	202,1	82,8	2,9
	28/20	253,0	186,8	47,2	5,4	256,9	179,8	53,3	4,8	264,1	183,8	59,0	4,5	264,4	190,3	65,6	4,0	251,9	192,9	72,7	3,5	251,1	201,3	83,8	3
	30/22	263,1	186,1	47,8	5,5	267,4	177,8	54,1	4,9	265,2	177,5	59,6	4,4	273,3	189,2	66,6	4,1	260,9	192,9	73,7	3,5	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																							
Airflow	Ta (°C)	D.B./W.B.	-7/-8			-5/-6			0/-1			2/1			7/6			12/11					
			kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP	kWt	kWe	COP			
46.000 m³/h	10	194,1	35,9	5,4	203,8	37,3	5,5	229,0	41,3	5,5	238,7	42,9	5,6	263,6	47,0	5,6	289,3	51,9	5,6				
	15	194,7	39,0	5,0	203,9	40,4	5,0	232,5	44,4	5,2	243,4	46,2	5,3	267,1	50,9	5,2	292,3	56,3	5,2				
	18	194,7	40,9	4,8	204,4	42,4	4,8	232,4	46,6	5,0	243,2	48,5	5,0	268,6	53,5	5,0	292,4	58,3	5,0				
	20	195,6	42,3	4,6	205,2	43,7	4,7	232,4	48,0	4,8	242,9	50,1	4,8	267,7	54,7	4,9	291,5	59,2	4,9				
	22	196,4	43,6	4,5	206,0	45,1	4,6	232,3	49,5	4,7	242,5	51,4	4,7	265,7	55,7	4,8	290,6	60,2	4,8				
	25	197,7	45,6	4,3	207,1	47,1	4,4	231,9	51,5	4,5	241,2	53,1	4,5	262,7	57,1	4,6	289,0	62,2	4,6				

Notes:

kWf = Cooling capacity in kW

kWe = Electrical power absorbed by the compressors in kW

kWs = Sensitive cooling capacity in kW

kWt = Heating capacity provided (kW)

EER referred only to compressors

COP referred only to compressors

Ta = Room air temperature D.B./W.B.

D.B. = Dry bulb

W.B. = Wet bulb

The cooling and heating performances do not take account of the heat dissipated by the motors and fans.

HE-RTU 300

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	20/12			25/18			30/22			35/24			40/25			45/26								
		D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
56.000 m³/h	22/16	271,8	207,5	52,7	5,1	299,1	213,3	59,3	5,0	299,6	207,3	66,0	4,5	290,2	208,4	73,3	4,0	277,1	212,1	81,5	3,4	273,1	223,9	91,9	3,0
	24/17	279,2	213,3	53,1	5,3	304,3	219,5	59,6	5,1	305,0	215,0	66,4	4,6	296,3	215,6	73,9	4,0	282,0	218,8	82,0	3,4	274,1	233,6	92,3	3,0
	26/18	286,5	219,1	53,4	5,4	300,3	219,5	60,2	5,0	310,3	222,2	66,9	4,6	301,2	223,6	74,3	4,0	286,4	226,1	82,3	3,5	281,7	238,1	93,8	3,0
	27/19	292,1	219,2	53,8	5,4	301,4	215,2	60,7	5,0	310,6	219,0	67,3	4,6	306,2	223,5	74,8	4,1	291,4	226,2	82,9	3,5	288,6	237,2	95,0	3,0
	28/20	297,9	219,1	54,2	5,5	302,4	210,9	61,2	4,9	310,9	215,6	67,6	4,6	311,3	223,2	75,3	4,1	296,6	226,3	83,4	3,6	295,6	236,2	96,2	3,1
	30/22	309,7	218,4	54,9	5,6	314,8	208,6	62,1	5,1	312,2	208,3	68,4	4,6	321,8	222,0	76,4	4,2	307,2	226,3	84,6	3,6	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in ON mode

Fresh air temperature (°C) D.B./W.B.																								
Airflow	Ta (°C)	-7/-8			-5/-6			0/-1			2/1			7/6			12/11							
		D.B.	kWt	kWe	COP	kWt	kWe	COP																
56.000 m³/h	10	225,8	42,0	5,4	237,2	43,6	5,4	266,4	48,4	5,5	277,8	50,2	5,5	306,8	55,0	5,6	336,6	60,8	5,5					
	15	226,5	45,7	5,0	237,3	47,3	5,0	270,5	51,9	5,2	283,3	54,1	5,2	310,8	59,6	5,2	340,1	65,9	5,2					
	18	226,6	47,8	4,7	237,8	49,6	4,8	270,4	54,5	5,0	283,0	56,8	5,0	312,5	62,6	5,0	340,3	68,2	5,0					
	20	226,6	47,8	4,7	237,8	49,6	4,8	270,4	54,5	5,0	283,0	56,8	5,0	312,5	62,6	5,0	340,3	68,2	5,0					
	22	228,6	51,0	4,5	239,7	52,8	4,5	270,3	58,0	4,7	282,1	60,1	4,7	309,2	65,2	4,7	338,1	70,5	4,8					
	25	230,0	53,4	4,3	241,0	55,1	4,4	269,8	60,3	4,5	280,6	62,2	4,5	305,7	66,8	4,6	336,2	72,8	4,6					

Cooling performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																									
Airflow	Ta (°C)	20/12			25/18			30/22			35/24			40/25			45/26								
		D.B./W.B.	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER	kWf	kWs	kWe	EER			
56.000 m³/h	22/16	267,8	205,2	54,1	4,9	294,8	210,9	60,8	4,8	295,2	205,0	67,6	4,4	285,9	206,0	75,2	3,8	273,0	209,7	83,5	3,27	269,1	221,4	94,2	2,9
	24/17	275,1	210,9	54,5	5,0	299,8	217,0	61,1	4,9	300,5	212,6	68,0	4,4	292,0	213,1	75,8	3,8	277,8	216,4	84,0	3,31	270,1	231,0	94,7	2,8
	26/18	282,2	216,6	54,8	5,1	295,9	217,0	61,7	4,8	305,7	219,7	68,5	4,5	296,7	221,1	76,2	3,9	282,2	223,6	84,4	3,34	277,6	235,4	96,2	2,9
	27/19	287,8	216,7	55,2	5,2	297,0	212,8	62,2	4,8	306,0	216,5	68,9	4,4	301,7	221,0	76,7	3,9	287,1	223,7	85,0	3,38	284,3	234,5	97,4	2,9
	28/20	293,5	216,6	55,6	5,3	298,0	208,5	62,7	4,7	306,4	213,2	69,3	4,4	306,7	220,7	77,2	4,0	292,2	223,8	85,5	3,42	291,2	233,5	98,6	2,9
	30/22	305,2	215,9	56,3	5,4	310,1	206,3	63,6	4,9	307,6	205,9	70,1	4,4	317,1	219,5	78,3	4,0	302,7	223,8	86,7	3,49	-	-	-	-

Heating performance with 30% of fresh air discharged and thermodynamic heat recovery in OFF mode

Fresh air temperature (°C) D.B./W.B.																								
Airflow	Ta (°C)	-7/-8			-5/-6			0/-1			2/1			7/6			12/11							
		D.B.	kWt	kWe	COP	kWt	kWe	COP																
56.000 m³/h	10	194,1	35,9	5,4	203,8	37,3	5,5	229,0	41,3	5,5	238,7	42,9	5,6	263,6	47,0	5,6	289,3	51,9	5,6					
	15	194,7	39,0	5,0	203,9	40,4	5,0	232,5	44,4	5,2	243,4	46,2	5,3	267,1	50,9	5,2	292,3	56,3	5,2					
	18	194,7	40,9	4,7	204,4	42,4	4,8	232,4	46,6	5,0	243,2	48,5	5,0	268,6	53,5	5,0	292,4	58,3	5,0					
	20	195,6	42,3	4,6	205,2	43,7	4,7	232,4	48,0	4,8	242,9	50,1	4,8	267,7	54,7	4,9	291,5	59,2	4,9					
	22	196,4	43,6	4,5	206,0	45,1	4,6	232,3	49,5	4,7	242,5	51,4	4,7	265,7	55,7	4,8	290,6	60,2	4,8					
	25	197,7	45,6	4,3	207,1	47,1	4,4	231,9	51,5	4,5	241,2	53,1	4,5	262,7	57,1	4,6	289,0	62,2	4,6					

Notes:

kWf = Cooling capacity in kW

kWe = Electrical power absorbed by the compressors in kW

kWs = Sensitive cooling capacity in kW

kWt = Heating capacity provided (kW)

EER referred only to compressors

COP referred only to compressors

Ta = Room air temperature D.B./W.B.

D.B. = Dry bulb

W.B. = Wet bulb

The cooling and heating performances do not take account of the heat dissipated by the motors and fans.

Performance of Summer Reheating coil with hot gas

HE-RTU 100

Fresh air temperature (°C) D.B./W.B.							
Airflow	Ta (°C)	25	27	30	32	35	
		kWt	kWt	kWt	kWt	kWt	
20.000 m³/h	10	34,8	38,5	42,7	45,6	50,9	
	12	33,4	36,2	39,5	42,7	48,1	
	14	29,4	33,0	35,8	38,8	44,6	
	16	27,5	30,2	33,9	36,5	42,2	
	18	25,1	27,5	31,6	34,7	38,4	
	20	21,5	24,8	28,8	31,6	35,7	

HE-RTU 150

Fresh air temperature (°C)							
Airflow	Ta (°C)	25	27	30	32	35	
		kWt	kWt	kWt	kWt	kWt	
26.000 m³/h	10	52,2	55,0	59,4	66,0	71,3	
	12	47,7	51,7	57,0	61,0	67,0	
	14	41,9	47,1	51,3	56,2	63,7	
	16	39,1	43,0	47,7	51,9	58,9	
	18	35,6	38,0	44,1	48,9	54,8	
	20	31,2	35,2	40,2	44,9	50,8	

HE-RTU 200

Fresh air temperature (°C)							
Airflow	Ta (°C)	25	27	30	32	35	
		kWt	kWt	kWt	kWt	kWt	
37.000 m³/h	10	69,3	76,8	85,2	90,8	101,4	
	12	66,6	72,1	78,8	85,2	95,9	
	14	58,6	65,8	71,4	77,3	88,9	
	16	54,8	60,2	67,6	72,8	84,1	
	18	50,0	54,9	63,0	69,1	76,6	
	20	42,8	49,5	57,4	63,0	71,1	

HE-RTU 250

Fresh air temperature (°C)							
Airflow	Ta (°C)	25	27	30	32	35	
		kWt	kWt	kWt	kWt	kWt	
46.000 m³/h	10	76,8	85,1	94,4	100,6	112,3	
	12	73,8	79,9	87,3	94,4	106,2	
	14	64,9	72,9	79,1	85,6	98,5	
	16	60,7	66,7	74,9	80,7	93,2	
	18	55,4	60,8	69,8	76,6	84,9	
	20	47,4	54,8	63,6	69,8	78,8	

HE-RTU 300

Fresh air temperature (°C)							
Airflow	Ta (°C)	25	27	30	32	35	
		kWt	kWt	kWt	kWt	kWt	
46.000 m³/h	10	93,2	103,3	114,6	122,2	136,4	
	12	89,6	97,1	106,0	114,6	129,0	
	14	78,9	88,5	96,0	104,0	119,6	
	16	73,8	81,0	91,0	98,0	113,1	
	18	67,3	73,8	84,7	93,0	103,1	
	20	57,5	66,5	77,3	84,7	95,7	

Notes:

Ta = temperature of air leaving the handling coil and entering the reheating coil

KWt = heating capacity provided (kW)

The reheating coil is fed by hot gas taken from the condenser coil.



Roccheggiani S.p.a.
Via 1^o Maggio, 10 - 60021 Camerano (An) Italy
Tel +39 071 730 00 23
Fax +39 071 730 40 05
info@roccheggiani.it

www.roccheggiani.it

ROCCHEGGIANI®
care for air